




TOWN OF ELBERTA

PARKS & PUBLIC
WORKS DIRECTOR
JOHNNIE
CRAWFORD
251 979-0455

CULVERT REQUIREMENTS

Standard requirements: (Refer to: Drainage & Stormwater Management Standards)

- 24 Feet Long (minimum)
- 18 inch or larger in Diameter (minimum)
- All pipes shall be laid in accordance with Town Standards
- The small material backfill shall be placed uniformly on each side of the pipe and compacted to 95% of relative density
- Minimum of 12 inches of compacted gravel, asphalt or cement over top of culvert
- Ends must be 45 degrees, cemented or sodded
- Concrete or black plastic corrugated pipe to ALDOT standards

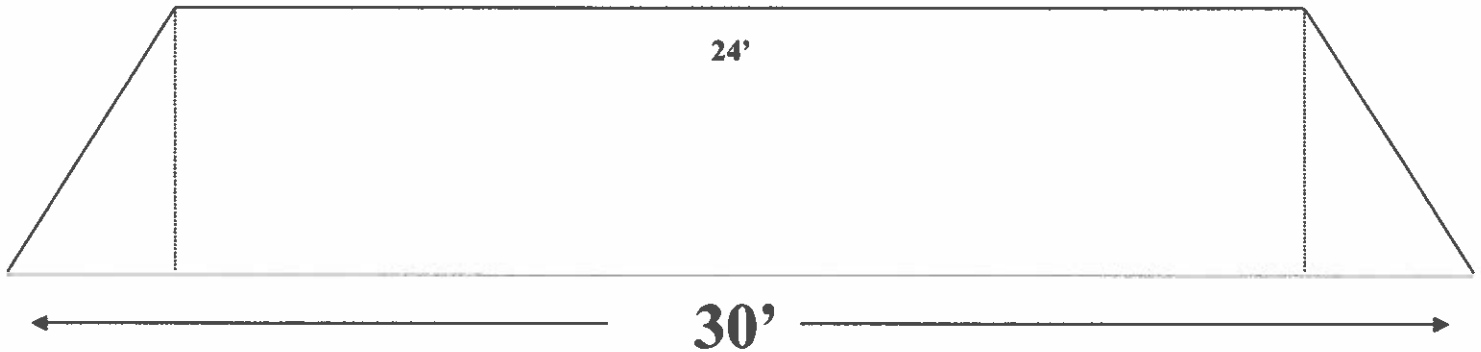

Public Works Director will determine the size for your property and must inspect after completion.
Refer to: Drainage & Stormwater Management Standards, Ordinance #2021-02

Name _____ Phone _____

Address _____

Address of culvert installation _____

Please attach a drawing of your property and where the culvert will be.

Approved _____ or Denied _____ Authorized by _____

A \$25.00 application fee is required.